


Typical Kitchen Application

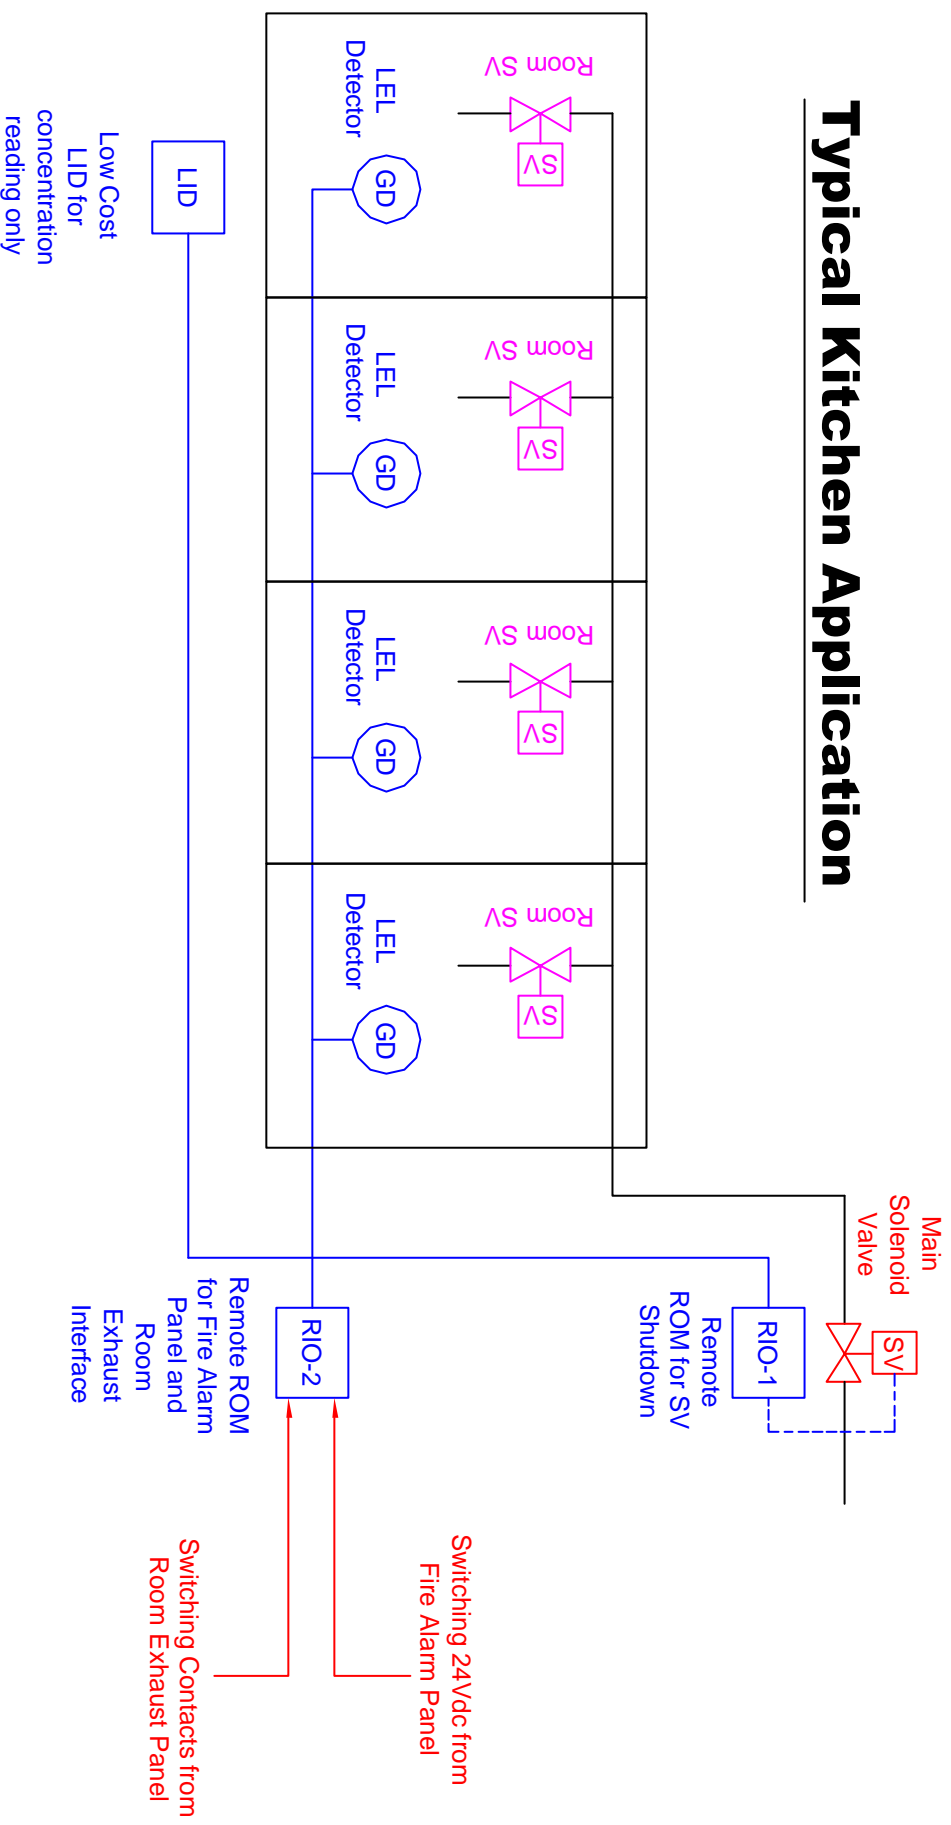

In the event of any of the following hazard conditions, the Main Solenoid Valve will be CLOSED.

1. Any room detected gas leakages.
2. Fire Alarm Panel contact triggered.
3. Room Exhaust contact triggered.

There should be a low cost Local Info Display providing information with regards to the concentration of each room or each individual detector.

Shutting down of each individual room is not required.